

## Quick Installation Guide

# Rubber Ring Jointing for PVC

## Installation

Rubber ring joints provide a fluid seal by compressing a rubber ring housed in the socket of a pipe or fitting when the spigot is passed into the socket.

Vinidex pipes and fittings may have one of several different design rubber ring joints, depending on the pipe type. The correct jointing rings are supplied with the pipe or fitting.

Consult the label on the pipe socket for information about the type of joint and for specific jointing instructions.

Series 1, Series 2, sewer rings or rings from other manufacturers cannot be interchanged.

Some Vinidex pipes incorporate a captive Rieber ring that is pre-installed in the factory and must not be removed in the field. This will be identified on the socket label.

Vinidex recommends using Vinidex jointing lubricant. Other lubricants may not be suitable for drinking water contact and may affect the ring. They should not be substituted without specific knowledge of these effects.



## Procedure

1. Pipes may be jointed out of the trench but it is preferable that connections be made in the trench to prevent possible "pulling" of the joint.
2. Check that the spigot end, if cut in the field, has a chamfer of approximately 12° to 15°. See the Appendix or chamfer dimensions and witness mark positions for Vinidex rubber ring joints.
3. Clean the socket, especially the ring groove. Do not use rag with lubricant on it.
4. Some pipes have captive rings which must not be removed in the field. For all other rubber ring joint types, clean and dry the ring and ring groove and insert the rubber ring into the groove as shown on the label.
5. Run your finger around the lead-in angle of the rubber ring to check that it is correctly seated, not twisted, and that it is evenly distributed around the ring groove.
6. Clean the spigot end of the pipe as far back as the witness mark. Ensure all burs are removed.
7. Apply Vinidex jointing lubricant to the spigot end as far back as the witness mark and especially to the chamfered section.

Note: Keep the rubber ring and ring groove free of jointing lubricant until the joint is actually being made.

8. Align the spigot with the socket and apply a firm, even thrust to push the spigot into the socket. It is possible to joint 100mm and 150mm diameter pipes by hand. However, larger diameter pipes such as 200 mm and above may require the use of a bar and timber block as illustrated. Alternatively, a commercially available pipe puller may be used to joint the pipes. Joint so that the witness mark is just showing

9. Brace the socket end of the line so that previously jointed pipes are prevented from closing up

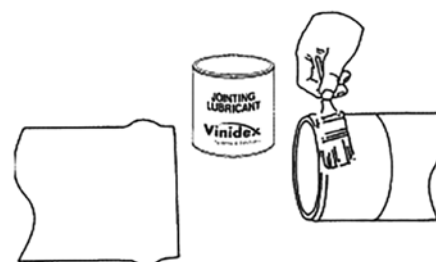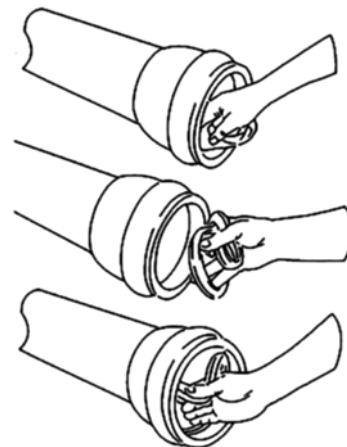


## Quick Installation Guide

### Rubber Ring Jointing for PVC


10. Inspect each joint to ensure that the witness mark is just visible at the face of each socket.
11. Pipe joints should not be pushed home to the bottom of the socket. The witness mark shows the optimum insertion depth. This is to allow for possible expansion of the pipe.
12. If a pipe joint is homed too far, it may be withdrawn immediately, but once the lubricant is dry (which takes only a few minutes in hot weather) mechanical aids are required to pull the joint apart.
13. With mechanical assistance, rubber ring joints can be recovered and re-made years after the original joint was made. New rubber rings should be used and care should be taken to ensure that there is no damage to pipe or socket.
14. If the joint is likely to be dismantled in the future the task is much easier if silicone lubricant is used.

Hint: If excessive force is required to make a joint, this may mean that the rubber ring has been displaced. To check placement of the ring without having to dismantle the joint, a feeler gauge can be inserted between the socket and pipe to check even placement of the ring.

#### TYPICAL RING CROSS-SECTION

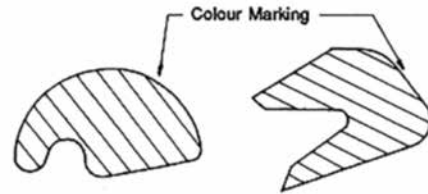

#### BAR & BLOCK JOINTING

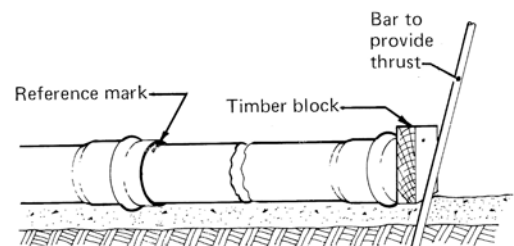

## Chamfering


Vinidex PVC pipes for rubber ring jointing are supplied with a chamfered end. However, if a pipe which has been cut in the field is to be used for making a rubber ring joint, the spigot end must be chamfered.

Special chamfering tools are available for this purpose, but in the absence of this equipment a body file can be used provided it does not leave any sharp edges which may cut the rubber ring. Do not

make an excessively sharp edge at the rim of the bore and do not chip or break this edge. Use a deburring tool if necessary to remove any sharp burrs or edges.

When a pipe is cut, a witness mark should be pencilled in. Care should be taken to mark the correct position.

For the correct chamfer lengths and witness mark positions, consult the Tables in the Appendix for the relevant pipe type.

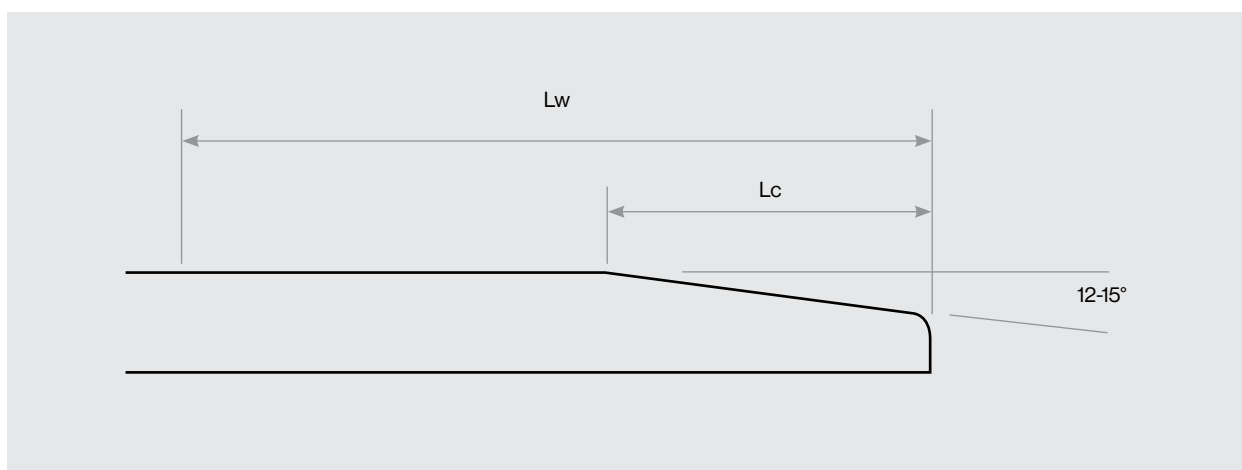

Lw – witness mark length, Lc= chamfer length.

Vinidex recommends that PVC Pressure pipes are installed in accordance with AS/NZS 2032 Installation of PVC pipe systems.

## Quick Installation Guide

# Rubber Ring Jointing for PVC

## Appendix - Joint Assembly and Control Dimensions for Vinidex Rubber Ring Jointed pipes

**Table 1: Rieber Ring Jointing Dimensions for Series 1 Vinidex PVC-U**

Pipe Size	Series	Pipe Class	Outside Diameter		Pipe Lengths				
			Mean		Chamfer		Witness Mark		Pipe End Squareness
			Dm		Lc		Lw	Lw	
DN		PN	MIN	MAX	MIN	MAX	MIN	MAX	mm
100	S1	6			6	9			
		9			9	13			
		12	114.1	114.5	9	13	120	124	4
		15			9	13			
125	S1	6			7	11			
		9			11	16			
		12	140	140.4	14	20	136	140	5
		15			14	20			
150	S1	6			8	12			
		9			13	18			
		12	160	160.5	14	19	146	150	6
		15			14	19			
200	S1	6			11	16			
		9			16	23			
		12	225	225.6	20	28	164	168	8
		15			20	28			
225	S1	6			12	17			
		9			18	25			
		12	250	250.7	19	27	172	176	9
		15			19	27			
250	S1	6			13	19			
		9			20	28			
		12	280	280.8	21	29	185	189	10
		15			21	29			
300	S1	6			15	21			
		9			20	29			
		12	315	315.9	20	29	193	197	11
		15			20	29			
375	S1	4.5			14	21			
		6			19	27			
		9	400	401	19	27	220	224	14
		12			19	27			
450	S1	15			19	27			
		6			23	35			
		9			23	35			
		12	500	501	23	35	260	264	17
		15			23	35			

## Quick Installation Guide

# Rubber Ring Jointing for PVC

**Table 2: Series 2 Vinidex Supermain® PVC-O**

Pipe Size	Series	Outside Diameter		Pipe Lengths				
		Mean		Chamfer		Witness Mark		Pipe End Squareness
		Dm		Lc		Lw	Lw	
DN		MIN	MAX	MIN	MAX	MIN	MAX	mm
100	S2	121.7	122.1	8	11	128	132	1
150	S2	177.1	177.6	12	16	144	148	2
200	S2	231.9	232.6	13	17	168	172	2
225	S2	258.9	259.6	14	18	178	182	2
250	S2	285.8	286.6	15	20	189	193	2
300	S2	344.9	345.8	18	24	209	213	2

## Quick Installation Guide

# Rubber Ring Jointing for PVC

**Table 3: Rieber Ring Jointing Dimensions for Series 1 Vinidex Hydro® PVC-M**

Pipe Size	Series	Pipe Class	Outside Diameter		Pipe Lengths				
			Mean		Chamfer		Witness Mark		Pipe End Squareness
			Dm		Lc		Lw	Lw	
DN		PN	MIN	MAX	MIN	MAX	MIN	MAX	mm
100	S1	6	114.1	114.5	6	9	132.0	136.0	1
		9			7	10			
		12			10	12			
		15			10	15			
125	S1	6	140	140.4	7	10	146.0	150.0	2
		9			9	12			
		12			11	15			
		15			13	19			
150	S1	6	160	160.5	8	11	152	156	2
		9			10	14			
		12			13	17			
		15			13	19			
200	S1	6	225	225.6	11	16	164.0	168.0	2
		9			13	19			
		12			17	25			
		15			17	25			
225	S1	6	250	250.7	12	16	171.0	175.0	2
		9			14	19			
		12			17	25			
		15			17	25			
250	S1	6	280	280.8	13	18	177.0	181.0	2
		9			16	21			
		12			19	28			
		15			19	28			
300	S1	6	315	315.9	15	21	188.0	192.0	2
		9			17	24			
		12			18	27			
		15			18	27			
375	S1	6	400	401	18	25	214.0	218.0	2
		9			21	29			
		12			24	35			
		15			24	35			
450	S1	6	500	501	22	30	250.0	254.0	3
		9			26	36			
		12			28	42			
		15			28	42			
500	S1	6	560	561	26	36	255.0	259.0	3
		9			30	44			
		12			30	44			
575	S1	6	630	631	27	43	265.0	269.0	3
		9			27	43			
		12			27	43			

## Quick Installation Guide

# Rubber Ring Jointing for PVC

**Table 4: Perth Polydex® Ring Jointing Dimensions for Series 1 Vinidex Hydro® PVC-M**

Pipe Size	Series	Pipe Class	Outside Diameter		Pipe Lengths				
			Mean		Chamfer		Witness Mark		Pipe End Squareness
			Dm		Lc		Lw	Lw	
DN		PN	MIN	MAX	MIN	MAX	MIN	MAX	mm
100	S1	6	114.1	114.5	7	9	95	99	1
		9			7	10			
		12			10	14			
125	S1	9	140.0	140.4	10	13	107	111	2
		12			13	17			
		12			13	17			
150	S1	6	160.0	160.5	9	12	114	118	2
		9			11	15			
		12			14	19			
200	S1	6	225.0	225.6	13	17	138	142	2
		9			16	21			
		12			16	21			
225	S1	6	250.0	250.7	15	20	148	152	2
		9			17	23			
		12			17	23			
250	S1	6	280.0	280.8	16	22	174	178	2
		9			19	25			
		12			19	25			
300	S1	6	315.0	315.9	16	21	185	189	2
		9			22	29			
		12			22	29			
375	S1	12	400.0	401.0	29	37	210	214	2
500	S1	6	560	561	26	36	255.0	259.0	3
		9			30	44			
		12			30	44			
575	S1	6	630	631	27	43	265.0	269.0	3
		9			12	27			
		12			27	43			

## Quick Installation Guide

# Rubber Ring Jointing for PVC

**Table 5: Rieber Ring Jointing Dimensions for Series 2 Vinidex Hydro® PVC-M**

Pipe Size	Series	Pipe Class	Outside Diameter		Pipe Lengths				
			Mean		Chamfer		Witness Mark		Pipe End Squareness
			Dm		Lc		Lw	Lw	
DN		PN	MIN	MAX	MIN	MAX	MIN	MAX	mm
100	S2	12	121.7	122.1	8	12	132.0	136.0	1
		16			10	16			
		18			11	18			
		20			11	18			
150	S2	12	177.1	177.6	11	17	148.0	152.0	2
		16			13	21			
		18			13	21			
		20			13	21			
200	S2	12	231.9	232.6	14	22	164.0	168.0	2
		16			15	24			
		18			15	24			
		20			15	24			
225	S2	6	258.9	259.6	10	16	175.0	179.0	2
		9			12	19			
		12			16	26			
		16			16	26			
		18			16	26			
250	S2	20			16	26	182.0	186.0	2
		6			11	18			
		9			13	21			
		12			17	27			
		16			17	27			
300	S2	18	344.9	345.8	17	27	199.0	203.0	2
		20			17	27			
		6			14	21			
		9			16	25			
		12			19	31			
375	S2	16	425.7	426.7	19	31	221.0	225.0	2
		18			19	31			
		20			19	31			
		6			17	26			
450	S2	9	506.5	507.5	20	30	251.0	255.0	2
		12			22	36			
		16			22	36			
		6			20	31			
450	S2	9	506.5	507.5	24	36	251.0	255.0	2
		12			25	41			
		16			25	41			
		6			20	31			
		9			24	36			
		12			25	41			
		16			25	41			
		9			27	43			
		12			27	43			

## Quick Installation Guide

# Rubber Ring Jointing for PVC

**Table 6: Perth VI Ring Jointing Dimensions for Series 2 Vinidex Hydro® PVC-M**

Pipe Size	Series	Pipe Class	Outside Diameter		Pipe Lengths				
			Mean		Chamfer		Witness Mark		Pipe End Squareness
			Dm		Lc		Lw	Lw	
DN		PN	MIN	MAX	MIN	MAX	MIN	MAX	mm
100	S2	12	121.7	122.1	10	13	103	107	1
		16			10	13			
		18			10	13			
		20			10	13			
150	S2	12	177.1	177.6	13	18	125	129	2
		16			13	18			
		18			13	18			
		20			13	18			
200	S2	12	231.9	232.6	16	22	169	173	2
		16			16	22			
		18			16	22			
		20			18	24			
225	S2	12	258.9	259.6	18	24	178	182	2
		16			18	24			
250	S2	12	285.8	286.6	20	27	189	193	2
		16			20	27			
		18			20	27			
		20			20	27			
300	S2	12	344.9	345.8	24	32	209	213	2
		16			24	32			
		18			24	32			
		20			24	32			
375	S2	12	425.7	426.7	32	40	237	241	2
		16			32	40			
		20			32	40			
450	S2	6	506.5	507.5	20	31	251.0	255.0	2
		9			24	36			
		12			25	41			
		16			25	41			
		9			27	43			
		12			27	43			

**Table 7: Vinidex RRJ DWV pipes**

Pipe Size	Outside Diameter		Pipe Lengths				
	Mean		Chamfer		Witness Mark		Pipe End Squareness
	Dm		Lc		Lw	Lw	
DN	MIN	MAX	MIN	MAX	MIN	MAX	mm
100	110.0	110.4	8	11	83	87	4
150	160.0	160.5	12	16	104	108	6
225	250.0	250.7	16	22	149	153	9
300	315.0	315.9	21	28	189	193	11

### Limitation of Liability

This product catalogue has been compiled by Vinidex Pty Limited ("the Company") to promote better understanding of the technical aspects of the Company's products to assist users in obtaining from them the best possible performance.

The product catalogue is supplied subject to acknowledgement of the following conditions:

1 The product catalogue is protected by copyright and may not be copied or reproduced in any form or by any means in whole or in part without prior consent in writing by the Company. 2 Product specifications, usage data and advisory information may change from time to time with advances in research and field experience. The Company reserves the right to make such changes at any time without further notice. 3 Correct usage of the Company's products involves engineering judgements, which can not be properly made without full knowledge of all the conditions pertaining to each specific installation. The Company expressly disclaims all and any liability to any person whether supplied with this publication or not in respect of anything and all of the consequences of anything done or omitted to be done by any such person in reliance whether whole or part of the contents of this publication. 4 No offer to trade, nor any conditions of trading, are expressed or implied by the issue of content of this product catalogue. Nothing herein shall override the Company's Condition of Sale, which may be obtained from the Registered Office or any Sales Office of the Company. 5 This product catalogue is and shall remain the property of the Company, and shall be surrendered on demand to the Company. 6 Information supplied in this product catalogue does not override a job specification, where such conflict arises; consult the authority supervising the job. © Copyright Vinidex Pty Limited.